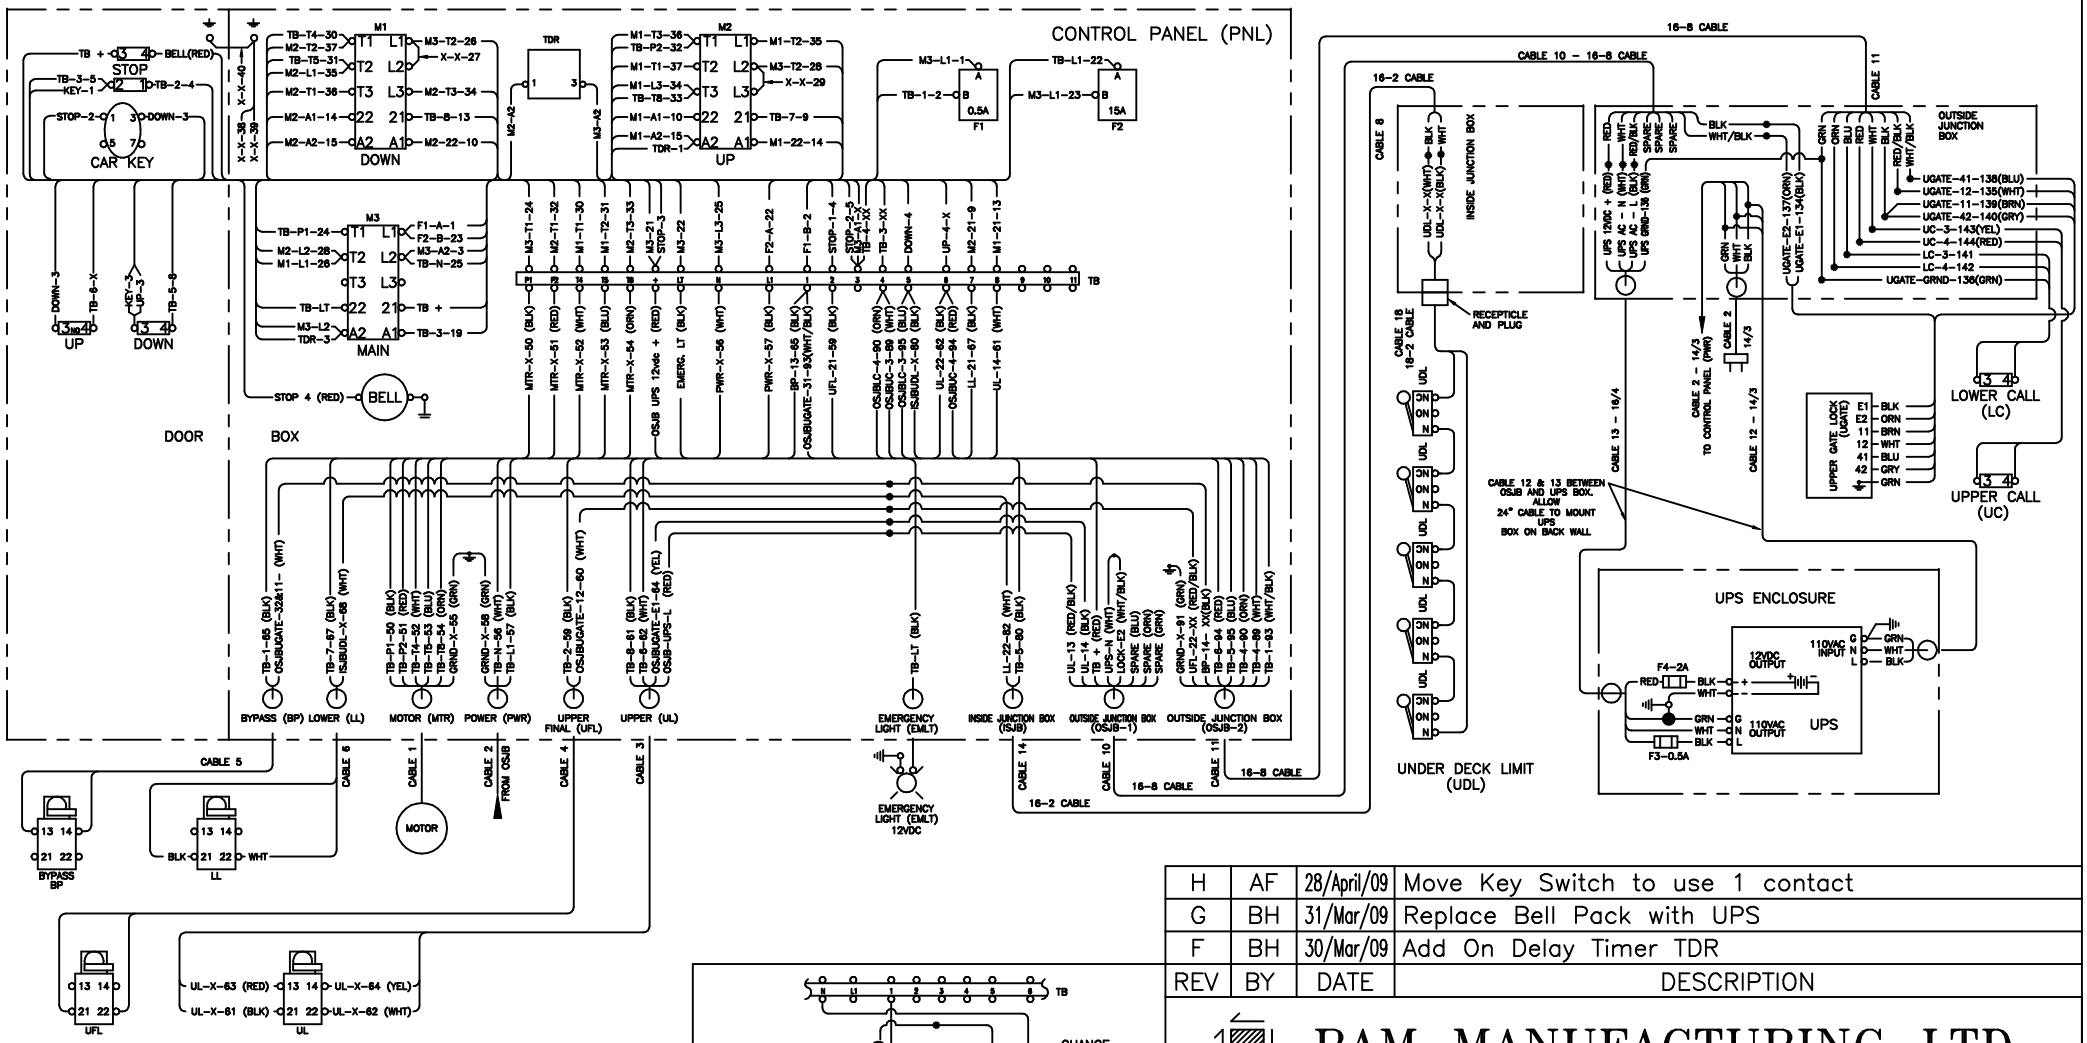

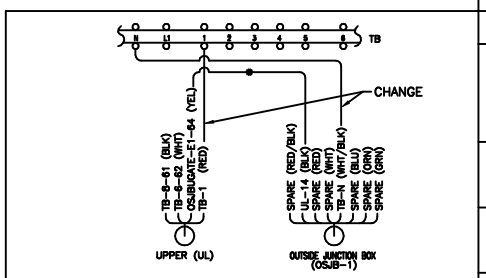

DETAIL #1
LIFT WITHOUT A UPS

REV	BY	DATE	DESCRIPTION
H	AF	28/April/09	Move Key Switch to use 1 contact
G	BH	31/Mar/09	Replace Bell Pack with UPS
F	BH	30/Mar/09	Add On Delay Timer TDR

RAM MANUFACTURING LTD.

DWN. BY: B. HANNAH

CHECKED BY:

COMMERCIAL TRUS-T-LIFT (CFG. 1)
UPPER GATE & SFTY. PAN
COMPLETE WIRING DIAGRAM

SCALE: N.T.S.

DATE: 29/12/97

DRAWING No. WMBTE002

REV H